

EASY CONFIG SYSTEM

A tablet is shown at an angle, displaying the LMS interface. The screen shows a course list on the left and a table of course details on the right. The table has columns for 'Serial', 'Name', 'Type', 'Field', 'ID', 'Status', 'Series', and 'Status'. There are buttons for 'Lecture' and 'Programmer'. Below the table, there is a section for 'COURSE CATEGORIES' with a list of categories and a button for 'Add New'. To the right of the tablet, there is a login panel with fields for 'User' and 'Password', a 'Log in' button, and a 'Language' dropdown menu.



1. DOWNLOAD AND INSTALLATION	4
1.1. Where to download ?	4
1.2. How to install ?	4
2. START-UP	5
2.1. Profiles	5
2.2. Create a new configuration	6
2.3. Main screen	7
2.4. Saving or opening a configuration	7
2.5. Connection modes	8
2.6. Connection modes – USB	8
2.7. Adding a device manually	9
2.8. Manual addition of a gateway/display	9
3. DEVICE LIST MENU	10
4. VISUALISATION MENU	11
5. CONFIGURATION MENU	12
5.1. Device configuration	12
6. SYSTEM CONFIGURATION MENU	13
6.1. Multi-menu and Multi-device programming	13
7. DUPLICATE A CONFIGURATION	14
7.1. Duplicate a configuration (device to device)	14
7.2. Duplicate a configuration (system to system)	14
8. AUTO-DISCOVERY PROCESS	17
9. CONFIGURING CONSUMPTION CURVES, LOAD CURVES AND TRENDS WITH DIRIS DIGIWARE	18
9.1. Configuration of Consumption Curves	18
9.2. Configuration of Load Curves	19
9.3. Configuration of Trends	20
10. FEATURES ASSOCIATED WITH THE TOKEN MODE	21
10.1. Introduction to the TOKEN mode	21
10.2. Alarm report on digital outputs of IO-10 module	21
10.2.1. Configuration	21
10.2.2. Visualisation	22
10.3. Tariff change via IO-10 module	23
10.3.1. Rules on the digital input states of the IO-10 module	24
10.4. Synchronisation of load curves via IO-10 module	25

OFFICE WHATSAPP NUMBER : 9223310978

1. DOWNLOAD AND INSTALLATION

1.1. Where to download ?

Go to <https://www.vrajlink.com/pricelist.php>

Minimum configuration required:


- Windows 7 and above
- Windows 64 bits only
- 2 Go of RAM
- 1 Go of hard disk
- Screen resolution: 1024 x 768

VRAJ LINK
vrajlink.com

1.2. How to install ?

Step 1: Unzip the "Easy Config System X.X.zip" file.

Step 2: Right-click on the .exe file and "Run as administrator".

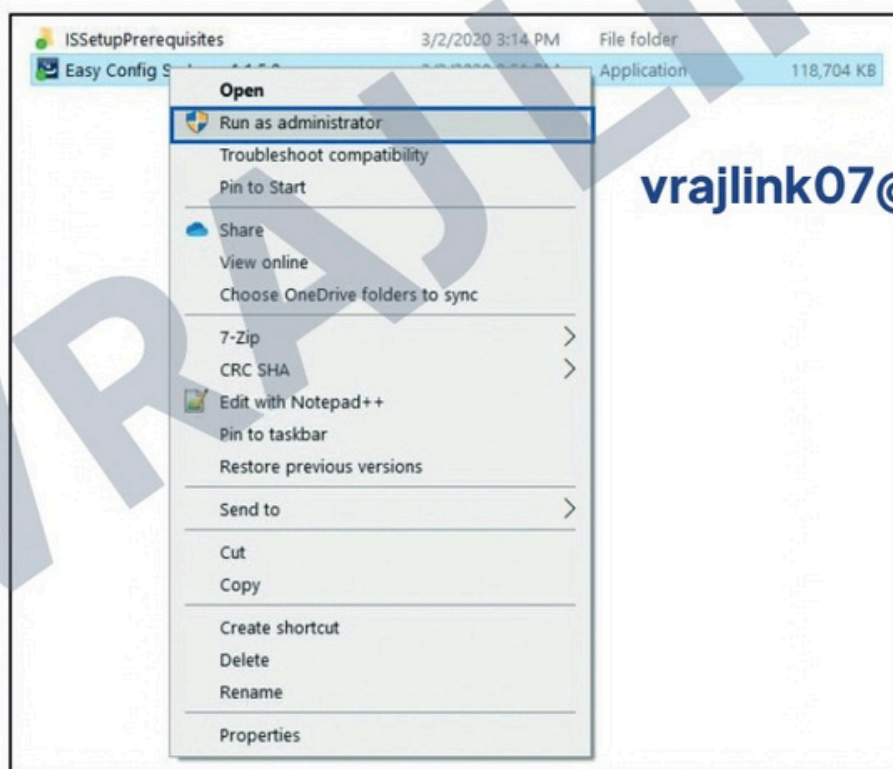

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

2. START-UP

2.1. Profiles

Profile	Default Password	Rights
User	None	• Visualisation • Limited configuration
Admin	Admin	• Visualisation • Full configuration • Save system • Open system • Save template • Upload template • Template management • Password modification

VRAJ LINK
vrajlink.com


vrajlink07@gmail.com



OFFICE WHATSAPP NUMBER : 9223310978


2.2. Create a new configuration

Step 1: Click on "New Configuration".

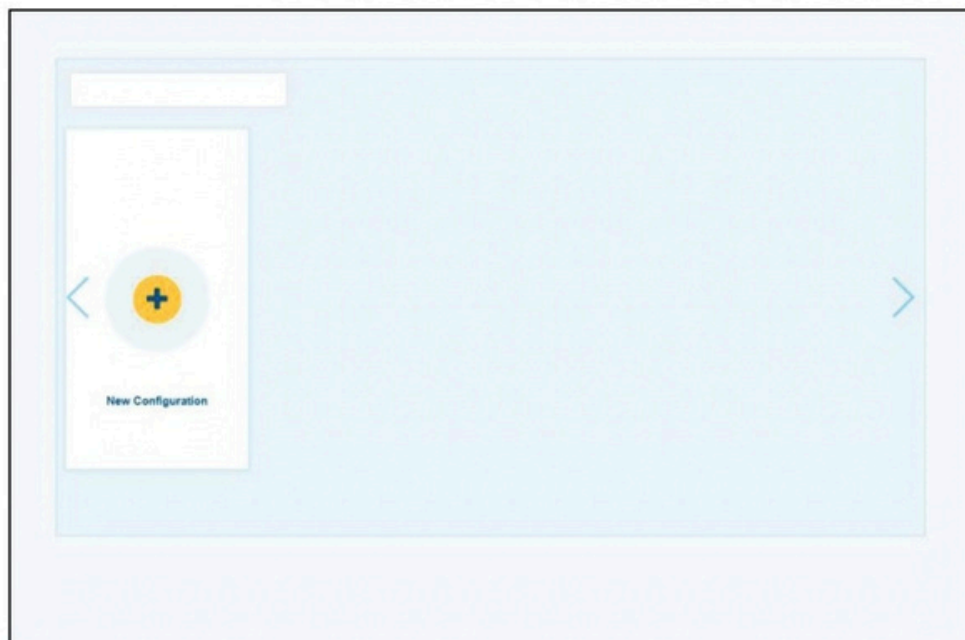


VRAJ LINK
vrajlink.com

Step 2: Name the configuration and choose an icon.

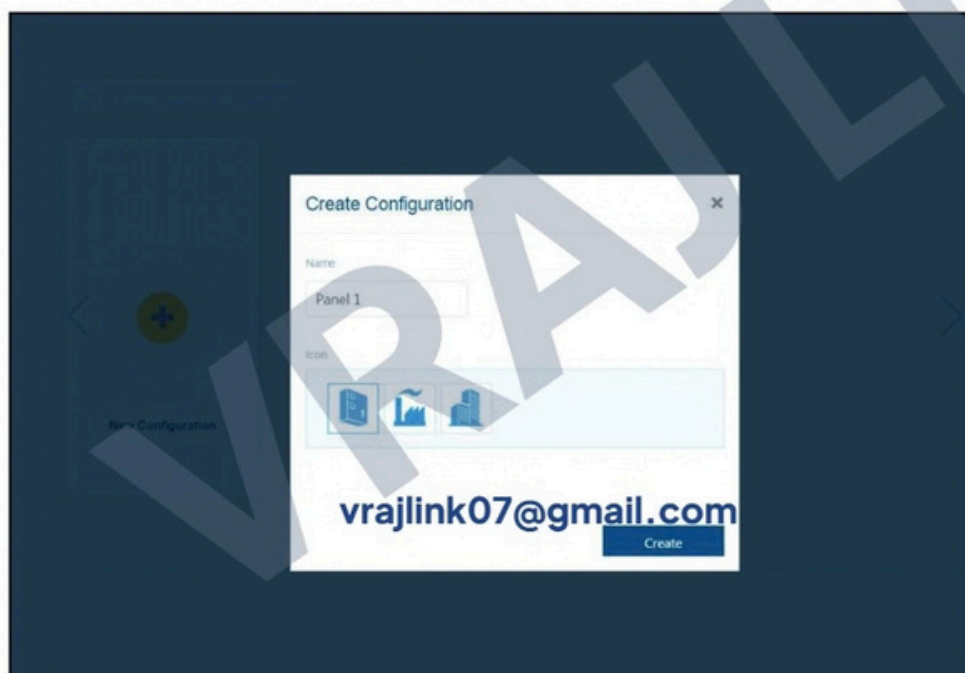


OFFICE WHATSAPP NUMBER : 9223310978

2.3. Main screen

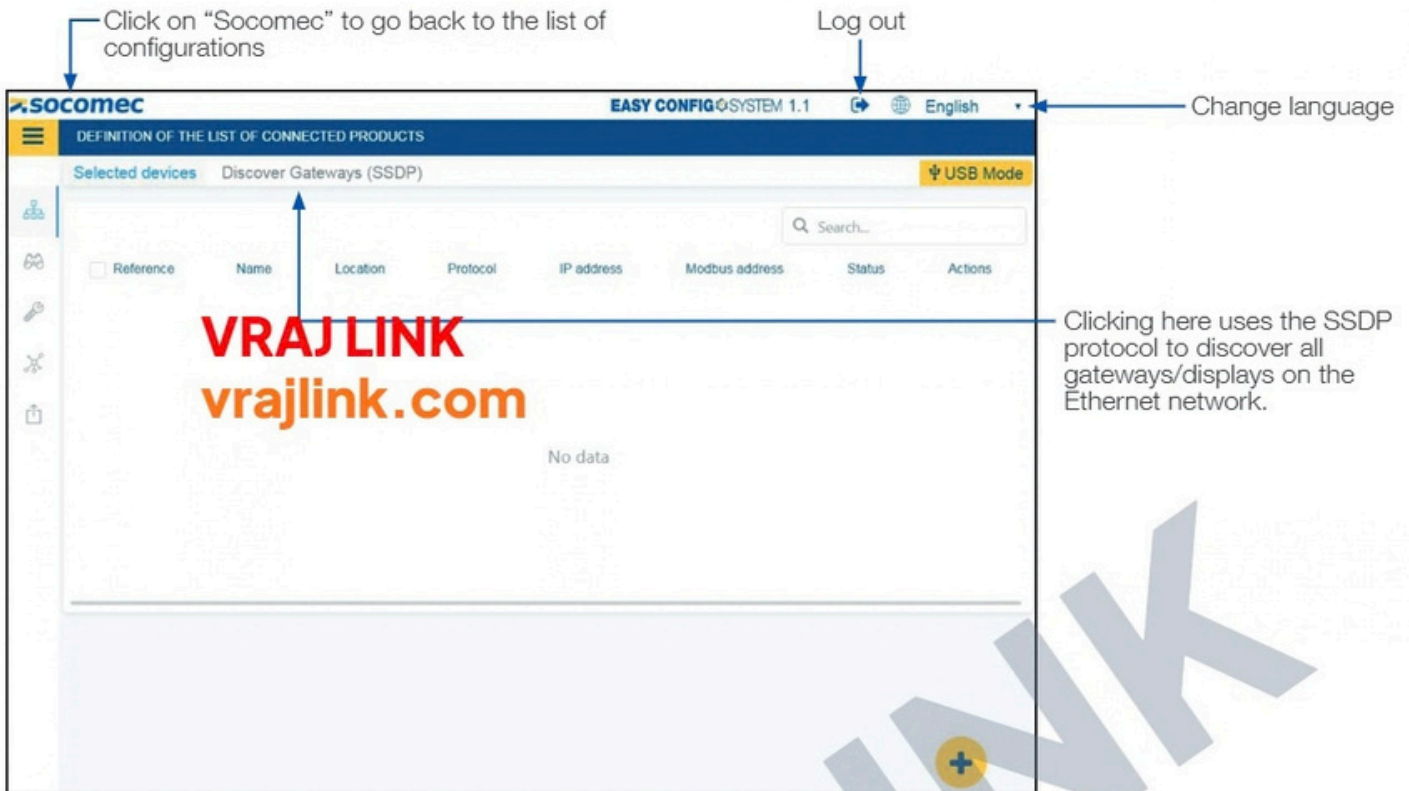

2.4. Saving or opening a configuration

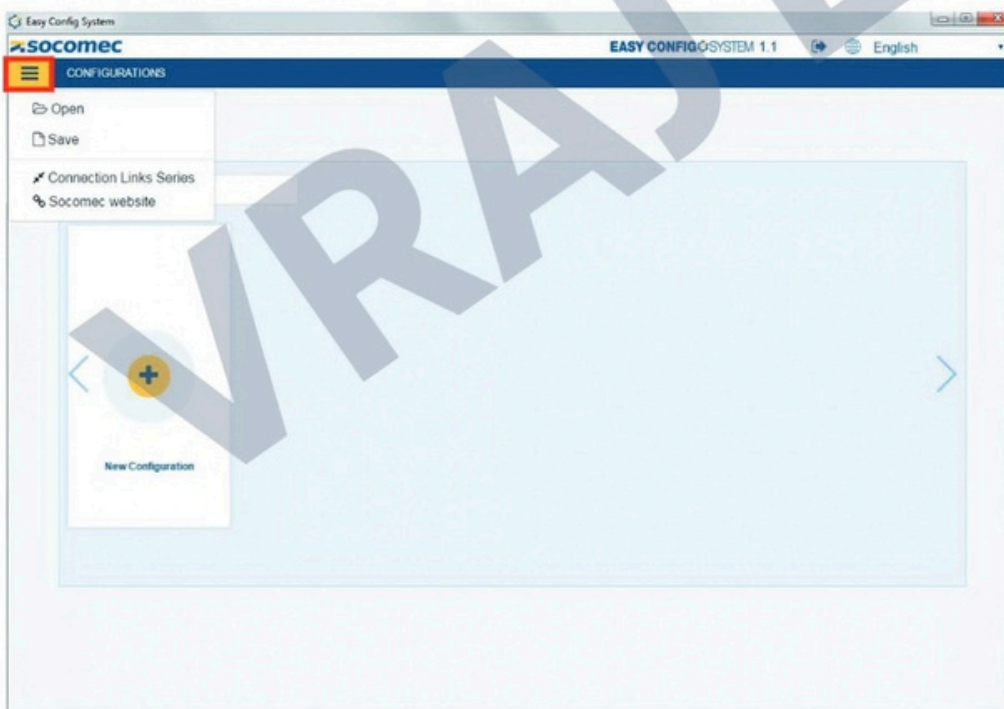


- Your system configurations can be saved and used again for another project.
- Instead of saving the configurations of individual devices, this allows you to save the configuration of an entire system.
- This will be particularly helpful if you need to configure multiple identical panels.

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

2.5. Connection modes

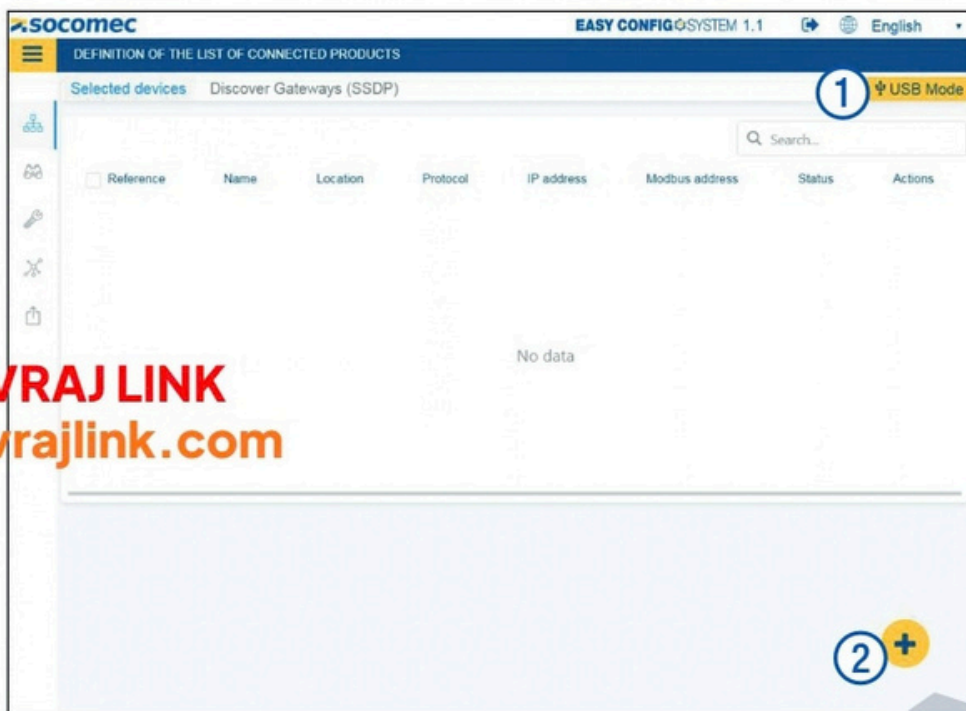

2 modes to connect to a device:

- 1 USB mode when your laptop is connected to a device via a USB cable.
- 2 "+" button to manually add a device connected over Ethernet or RS485.

VRAJ LINK
vrajlink.com

2.6. Connection modes – USB



- Connect a USB cable between your PC and a Socomec device.
- Click on USB mode.
- The device will be added.


vrajlink07@gmail.com



Note: When adding a D-xx display or M-xx gateway, all slaves will also be added (providing the Auto-Discovery was done already).

OFFICE WHATSAPP NUMBER : 9223310978

2.7. Adding a device manually

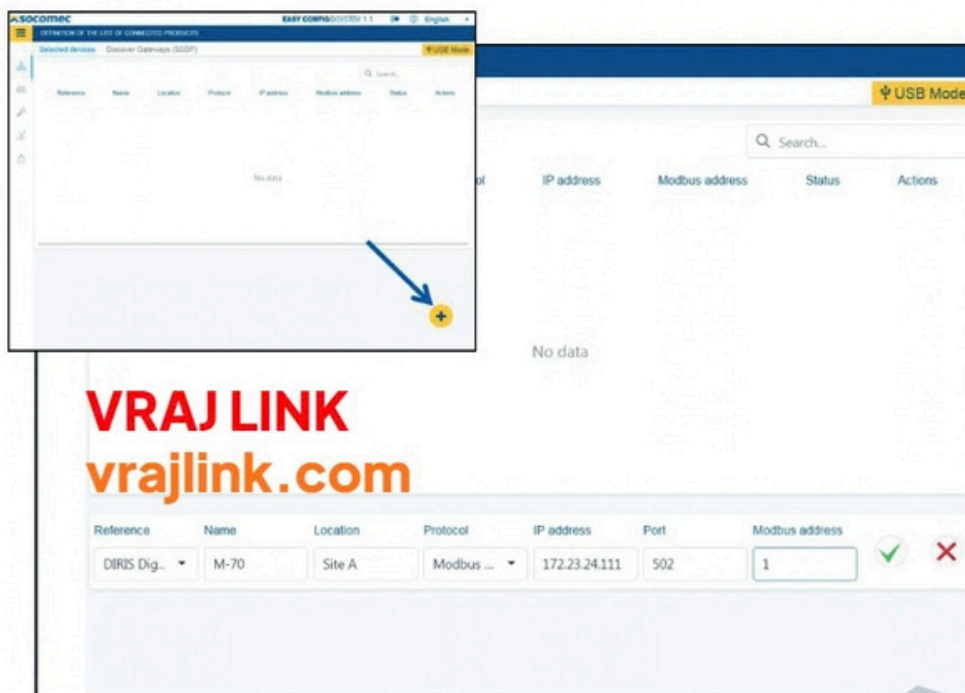


Reference	Name	Location	Protocol	IP address	Port	Modbus address	Status	Actions
DIRIS Dig...	M-70	Site A	Modbus ...	172.23.24.111	502	1	✓	✗

- Enter communication details for the device you wish to add:
 - Device type
 - Name
 - Location
 - Communication protocol
 - IP address
 - Communication port
 - Modbus Address



When adding a D-xx display or M-xx gateway, all slaves will also be added (providing the Auto-Discovery was done already) ➔ See chapter 2.8.

2.8. Manual addition of a gateway/display

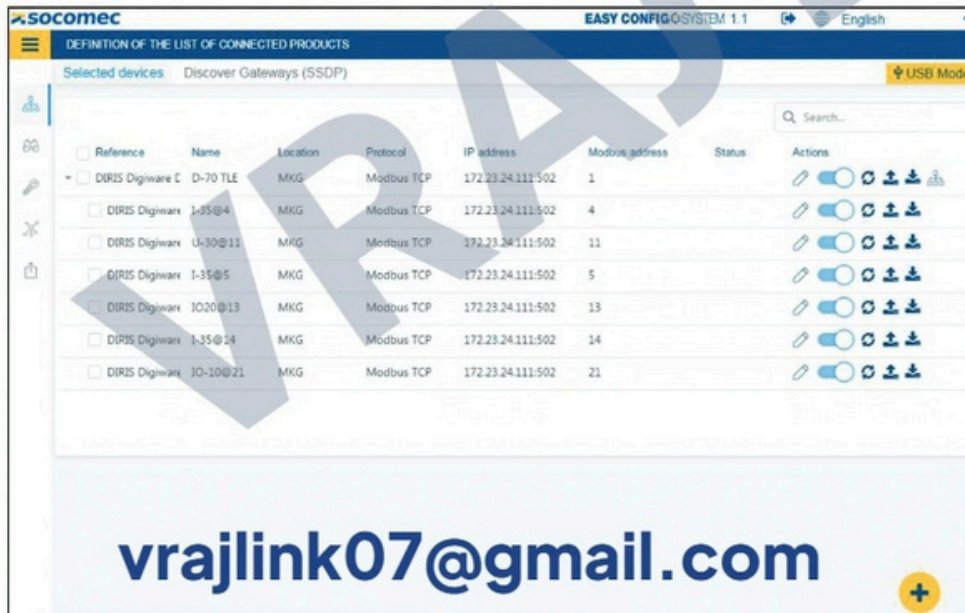


Reference	Name	Location	Protocol	IP address	Modbus address	Status	Actions
☐ DIRIS Digiswars C D-70 TLE	MKG	Modbus TCP	172.23.24.111:502	1	ⓘ ⚙ ⚙ ⚙ ⚙		
☐ DIRIS Digiswars I-35@4	MKG	Modbus TCP	172.23.24.111:502	4	ⓘ ⚙ ⚙ ⚙ ⚙		
☐ DIRIS Digiswars U-30@11	MKG	Modbus TCP	172.23.24.111:502	11	ⓘ ⚙ ⚙ ⚙ ⚙		
☐ DIRIS Digiswars I-35@5	MKG	Modbus TCP	172.23.24.111:502	5	ⓘ ⚙ ⚙ ⚙ ⚙		
☐ DIRIS Digiswars IO20@13	MKG	Modbus TCP	172.23.24.111:502	13	ⓘ ⚙ ⚙ ⚙ ⚙		
☐ DIRIS Digiswars I-35@14	MKG	Modbus TCP	172.23.24.111:502	14	ⓘ ⚙ ⚙ ⚙ ⚙		
☐ DIRIS Digiswars IO-10@21	MKG	Modbus TCP	172.23.24.111:502	21	ⓘ ⚙ ⚙ ⚙ ⚙		

- If the Auto-Discovery process was launched before, all slave devices will be added as shown on the screen capture.

OFFICE WHATSAPP NUMBER : 9223310978

3. DEVICE LIST MENU


VRAJ LINK

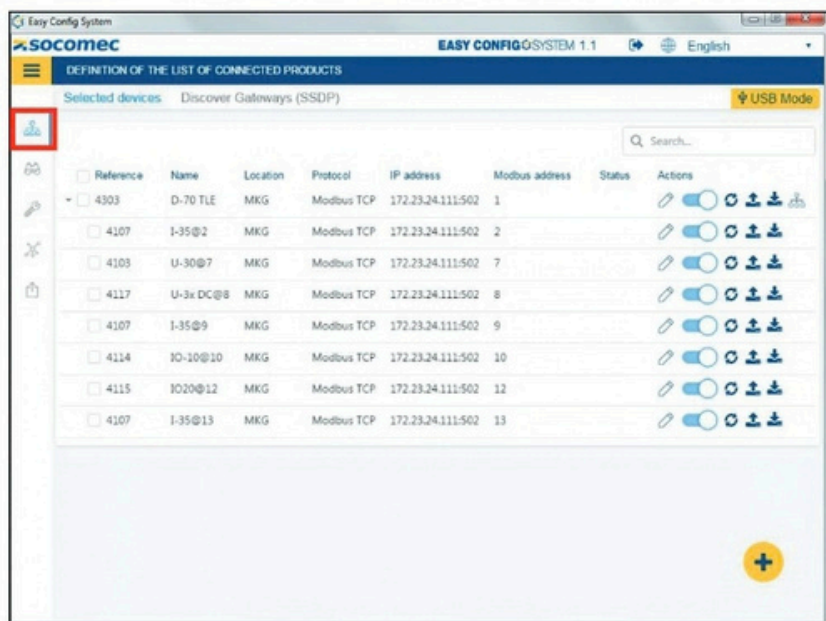

- From this menu, you can find the list of devices present within the configuration.

vrajlink.com

- One or several gateways/displays can be listed, each with their own slave devices.

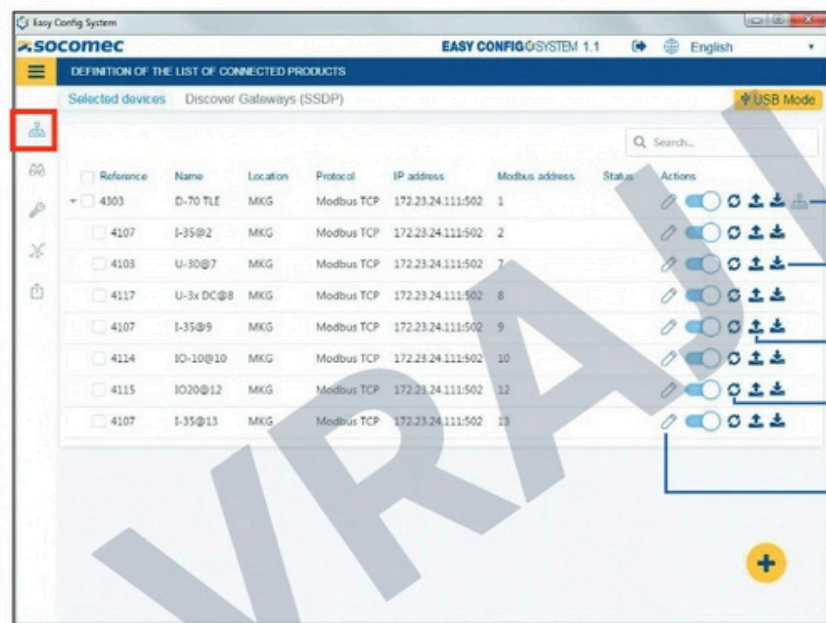

Refresh the gateway/display's topology

Save the device's configuration

Upload a saved configuration to the device

Reset the device's default settings in Easy Config

Modify the device's details (name, location etc.)

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

4. VISUALISATION MENU



- From this menu (1), the list of devices is shown in the “Organisation” part (2).

- In the “DATA” part (3), select data to visualise.

VRAJLINK
vrajlink.com


- Each device has a custom dashboard.

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

5. CONFIGURATION MENU

5.1. Device configuration

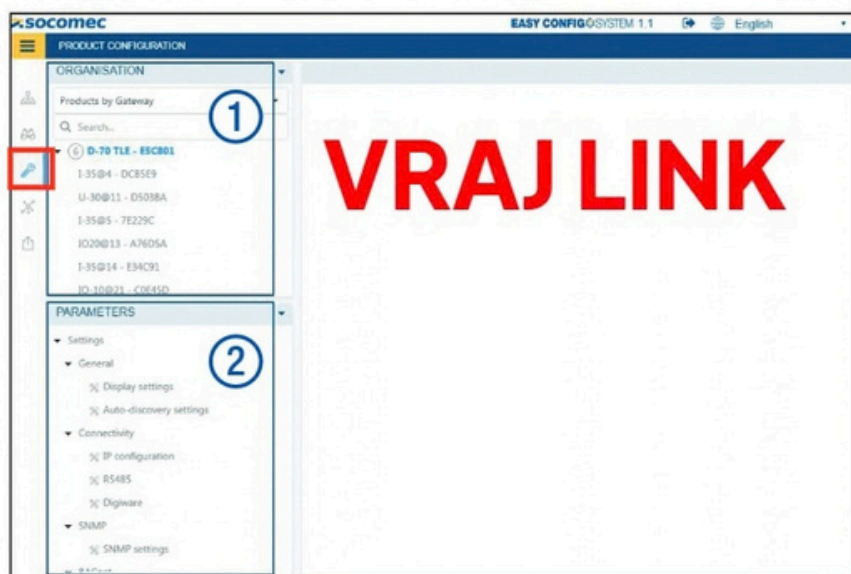


- From this menu (1), the list of devices is shown in the "Organisation" part (2).

vrajlink.com

- In the "DATA" part (3), select data to visualise. Each device has a custom dashboard.

When parameters are modified, an icon appears next to the modified menu and next to the modified device.

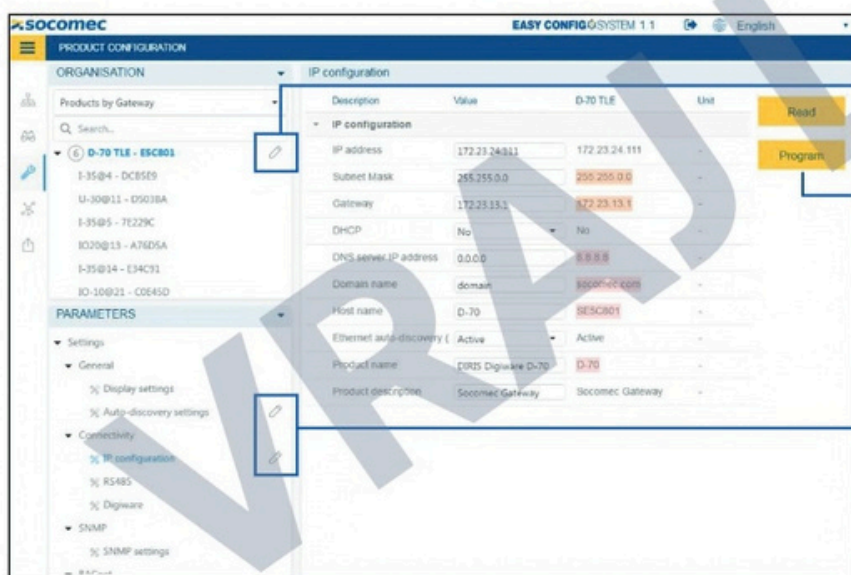

Parameters were modified for this device but configuration has not been sent to the device yet.

Click on program to send the configuration (for this menu only) to the device.

This does not send the configuration of other configuration menus.


Some parameters have been modified within this menu, but changes were not sent to the device yet.

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

6. SYSTEM CONFIGURATION MENU


6.1. Multi-menu and Multi-device programming

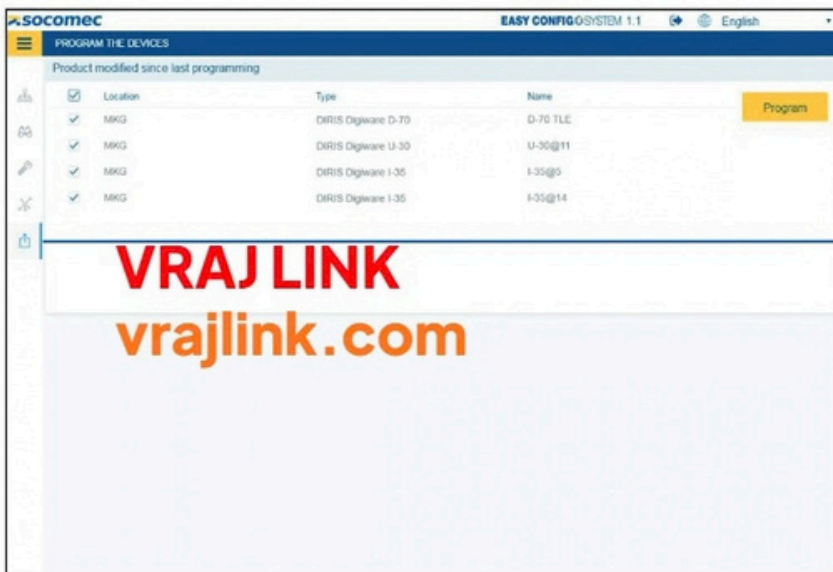


• This menu is used to send the configuration to multiple devices at the same time.

• All devices that have been modified and not yet configured are listed in this menu.

• This menu is particularly handy and quick if you have modified the configuration within several tables, and for multiple devices.

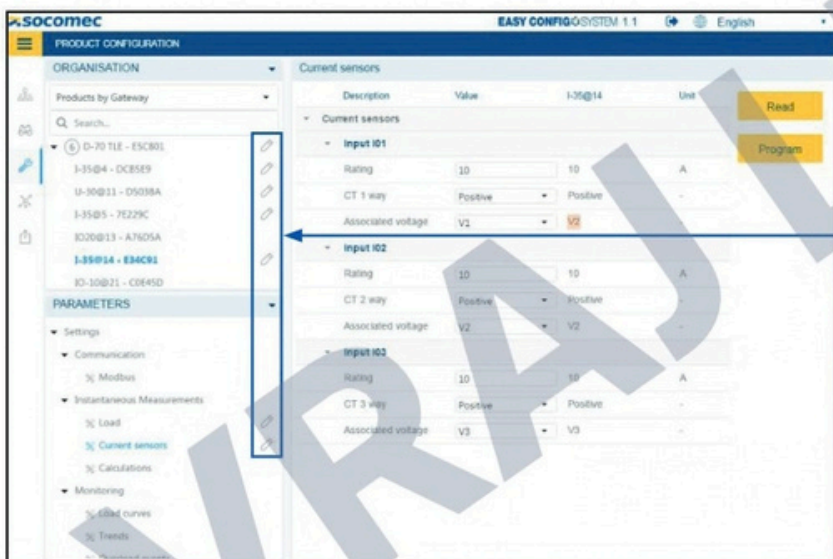

1 Several configuration menus or devices have been modified (indicated by the pencil icon) and waiting to be configured.

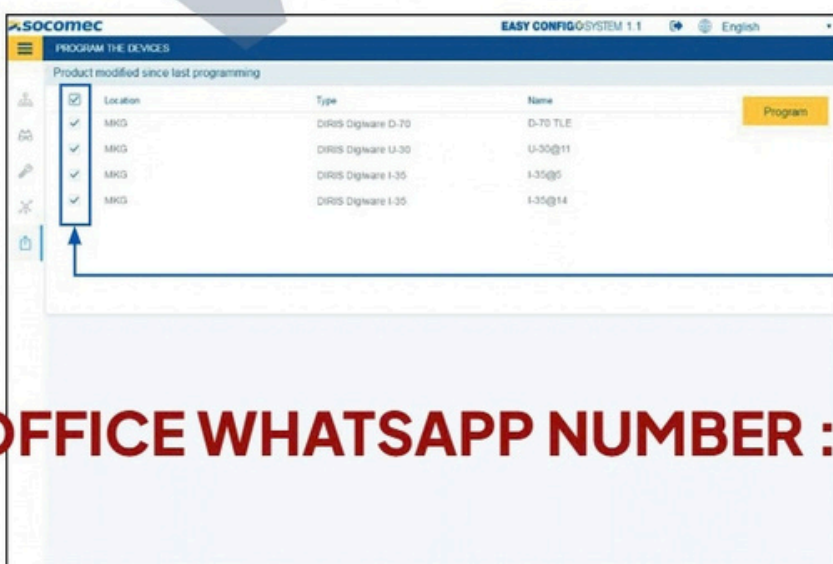

vrajlink07@gmail.com

2 All devices which have been modified but not yet configured are listed.


Click on Program to send the configuration to all devices.

OFFICE WHATSAPP NUMBER : 9223310978

7. DUPLICATE A CONFIGURATION

VRAJ LINK

7.1. Duplicate a configuration (device to device)

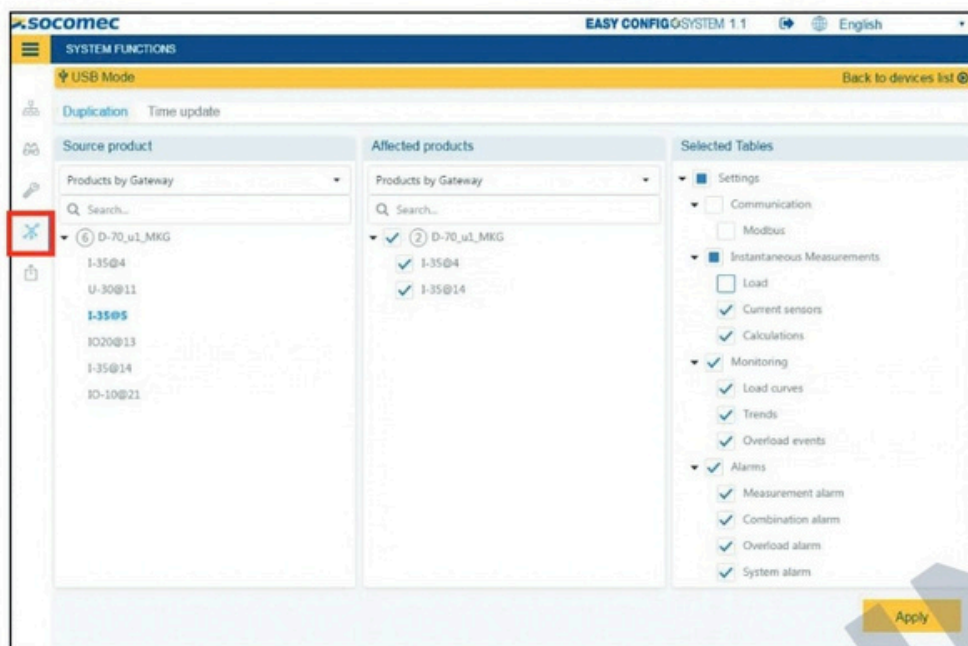

vrajlinc.com

This menu is used to duplicate the configuration of a device into another device of the same type.

Ex:
Choose a source product (I-35).

All other I-35 modules are then listed in the "Affected product" part.

Choose the ones you want to apply the configuration of the source I-35 and then select the tables you want to apply.





Don't forget to uncheck the menus you don't want to duplicate (Modbus, etc.). After clicking on "Apply", don't forget to send the configuration to the devices.


7.2. Duplicate a configuration (system to system)

- **Step 1:** Connect to a system (named System 1), via USB or Ethernet.
- **Step 2:** Configure a System.
- **Step 3:** Save the system configuration.
- **Step 4:** Create a new configuration.
- **Step 5:** Connect to the new system (named System 2).
- **Step 6:** Do the auto-discovery and change Modbus addresses to have the same Modbus mapping as System 1.
- **Step 7:** Go to the Duplication menu (see next page).

vrajlinc07@gmail.com

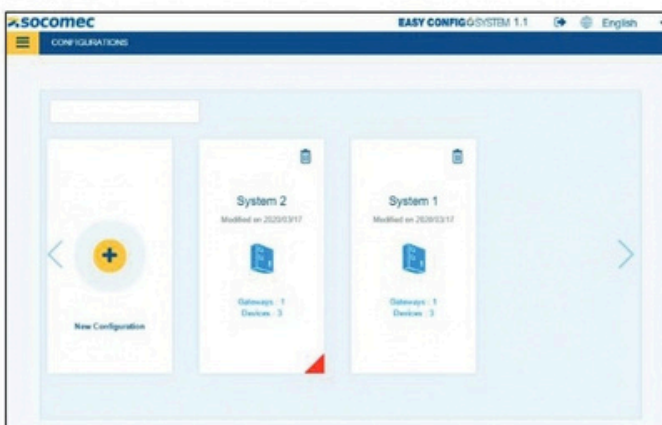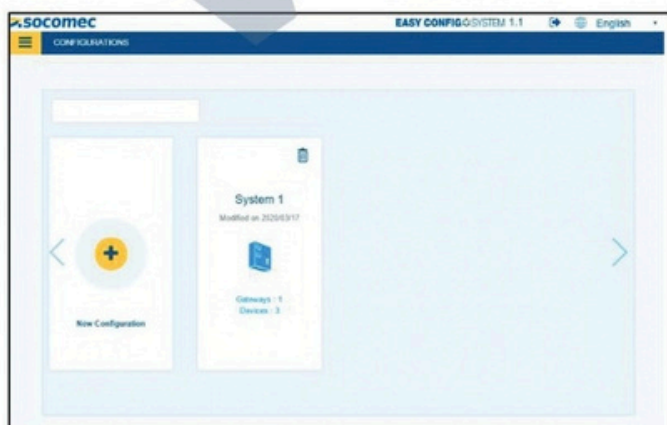

OFFICE WHATSAPP NUMBER : 9223310978

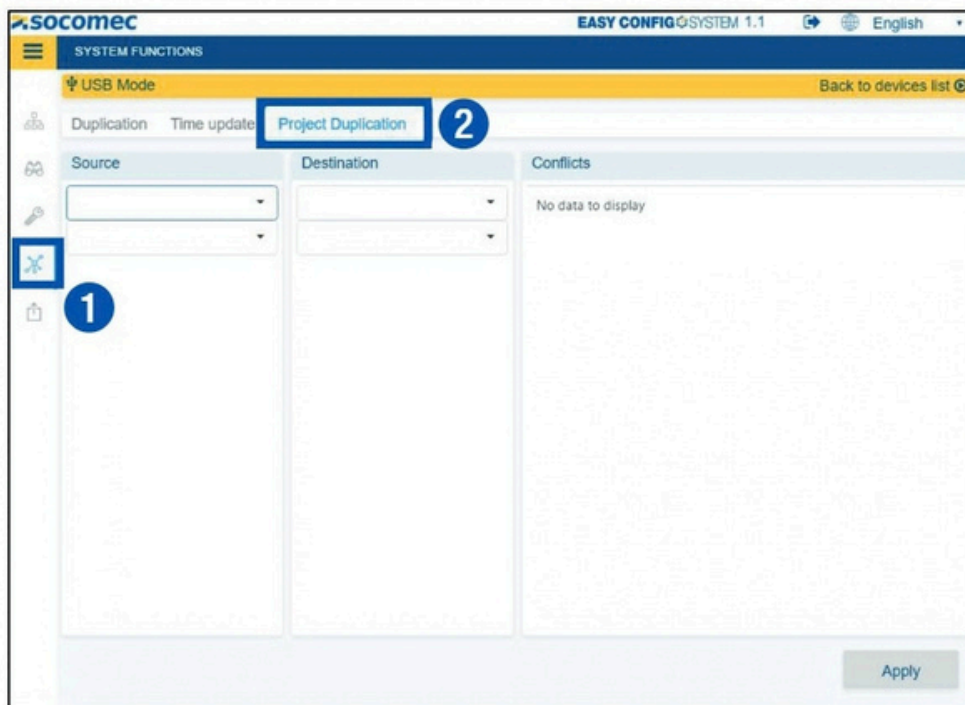


• This menu is used to duplicate a system configuration and apply it to a new system (for instance a DIRIS Digiware system).

• Go to the Duplication menu (1).

• Click on "Project Duplication" (2).

VRAJ LINK
vrajlink.com

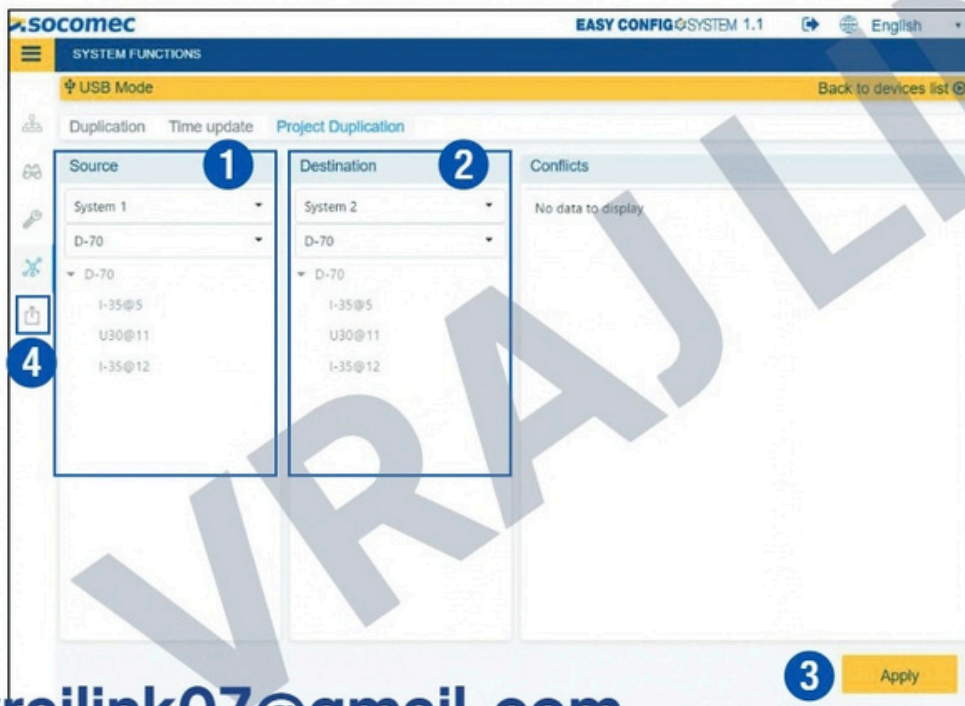

• Select the "Source" system (1).

• Select the "Destination" system (2).

• Click on "Apply" at the bottom right corner of the screen (3).


• Click on the "System configuration" menu (4).

vrajlink07@gmail.com



The "Destination" system must have the same Modbus mapping as the "Source" system. The Auto-discovery process and Modbus addressing of the "Destination" system must therefore be done prior to using the duplication function.

OFFICE WHATSAPP NUMBER : 9223310978

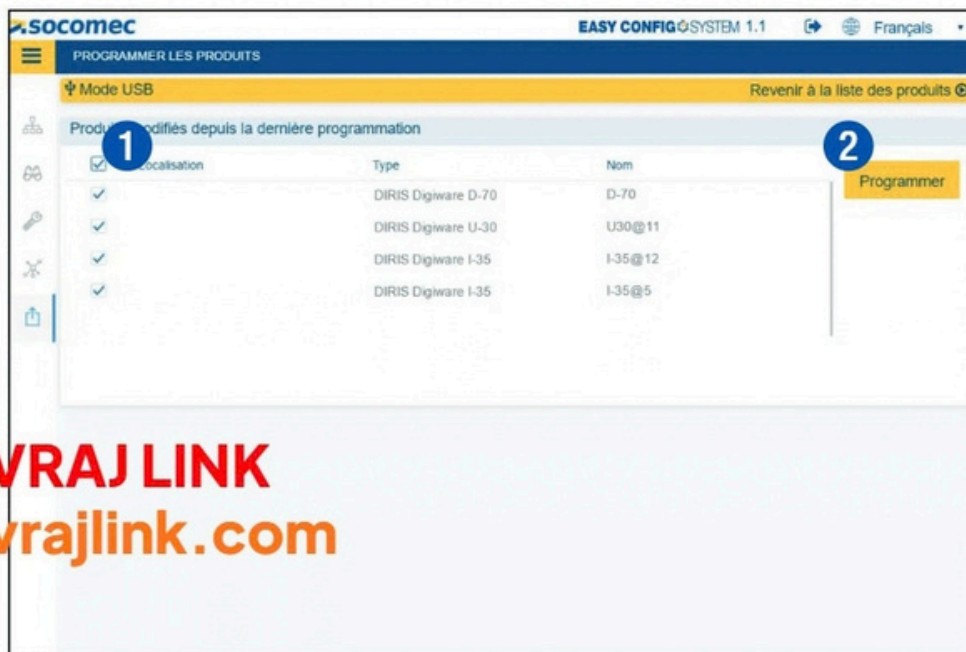

- Select all devices within system 2 (1).
- Click on "Program" to send the configuration to devices in system 2 (2).

VRAJ LINK
vrajlink.com

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

8. AUTO-DISCOVERY PROCESS

Launched from the dashboard of D-xx displays or M-xx gateways.

Picture 1

- From the Visualisation menu, click on the dashboard of the D-xx display/M-xx gateway (picture 1).


VRAJ LINK
vrajlink.com

- Click on "Auto-discovery" (picture 2).

- The Auto-Discovery from Easy Config System **doesn't generate any conflict**. The M-xx gateway/D-xx displays automatically assigns a Modbus address to each device.

- Once the Auto-Discovery process is completed, the list of devices is displayed at the bottom, and you can change the Modbus address of all devices (picture 3).

- The unique ID and the "Blink" function which makes the slave's ON LED blink for 10 seconds allow you to quickly identify the module inside electrical panels (picture 3).

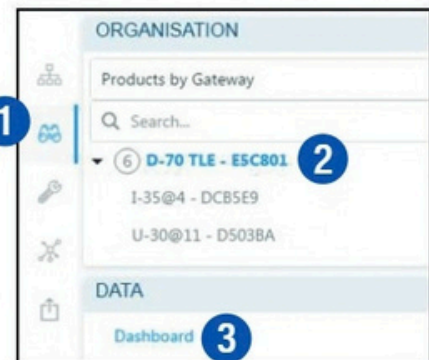


Picture 2



Picture 3

		Cancel modbus addresses		Validate modbus addresses						
Bus	Type	Name	ID	M. ↑	Version	Date/Time	Com status	Actions		
Digiware	DIRIS Digiware I-35	I-35@5	DCB5E9	5	1.9.1	17/03/2020 18:07:30	Good	⚡		
Digiware	DIRIS Digiware U-30	U30@11	D503BA	11	1.9.0	17/03/2020 18:07:29	Good	⚡		
Digiware	DIRIS Digiware I-35	I-35@12	E84C91	12	1.9.1	17/03/2020 18:07:30	Good	⚡		

- Once the Auto-Discovery process is completed, the list of slave devices is also updated in the organisation part on the left sidebar.

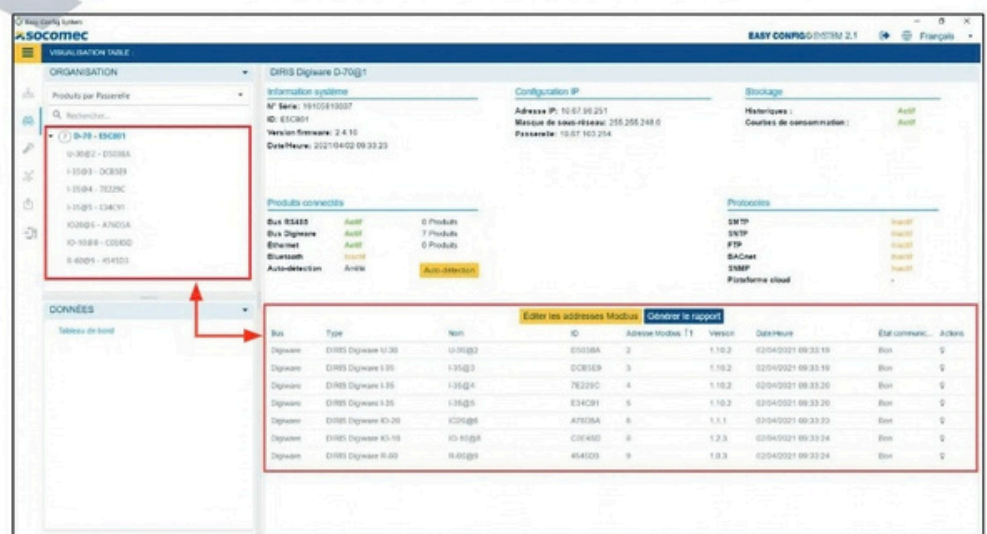


vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

9. CONFIGURING CONSUMPTION CURVES, LOAD CURVES AND TRENDS WITH DIRIS DIGIWARE

9.1. Configuration of Consumption Curves

- From the DIRIS Digiware D-70 display or DIRIS Digiware M-70 gateway:

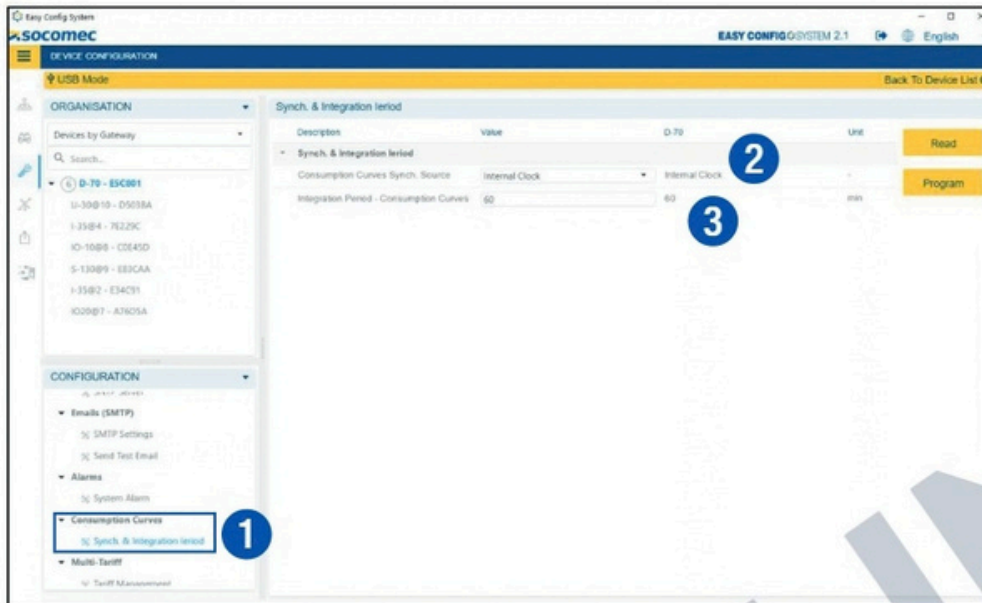

VRAJ LINK



- 1 Go to the "Consumption curves" menu.
- 2 Choose the Synchronisation Source:
 - Internal clock
 - External comm signal
- 3 Choose the integration period for consumption curves.

vrajlink.com

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978


9.2. Configuration of Load Curves

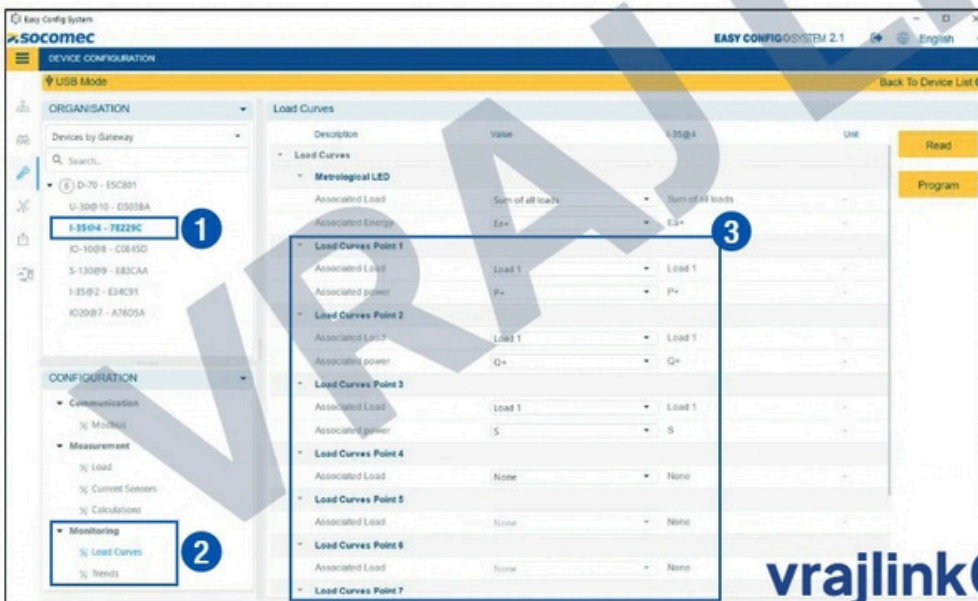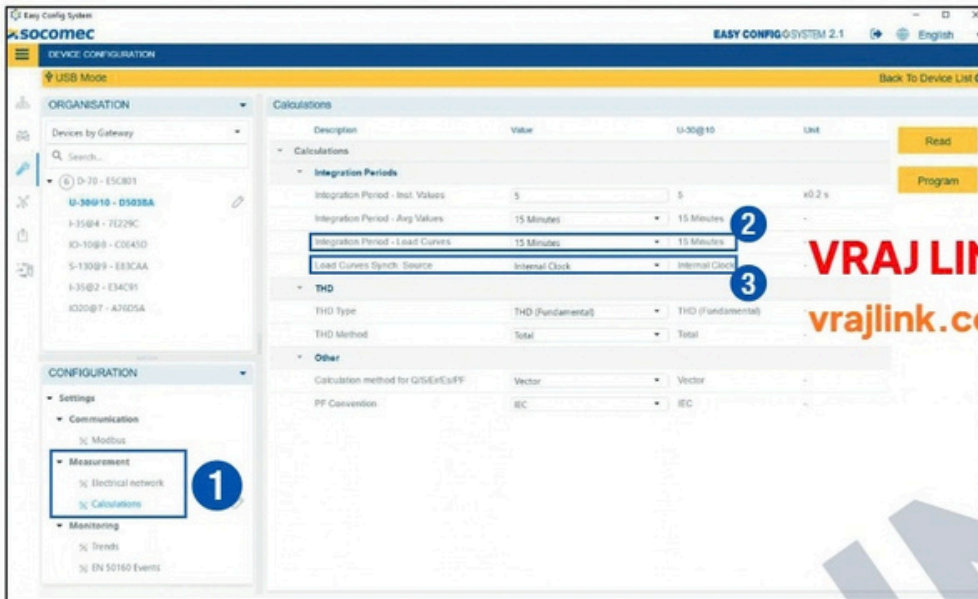

OFFICE WHATSAPP NUMBER : 9223310978


9.3. Configuration of Trends

- On the DIRIS Digiware U module, go to the "Calculation" menu (1) and select the integration period for Trends (Avg. values) (2).

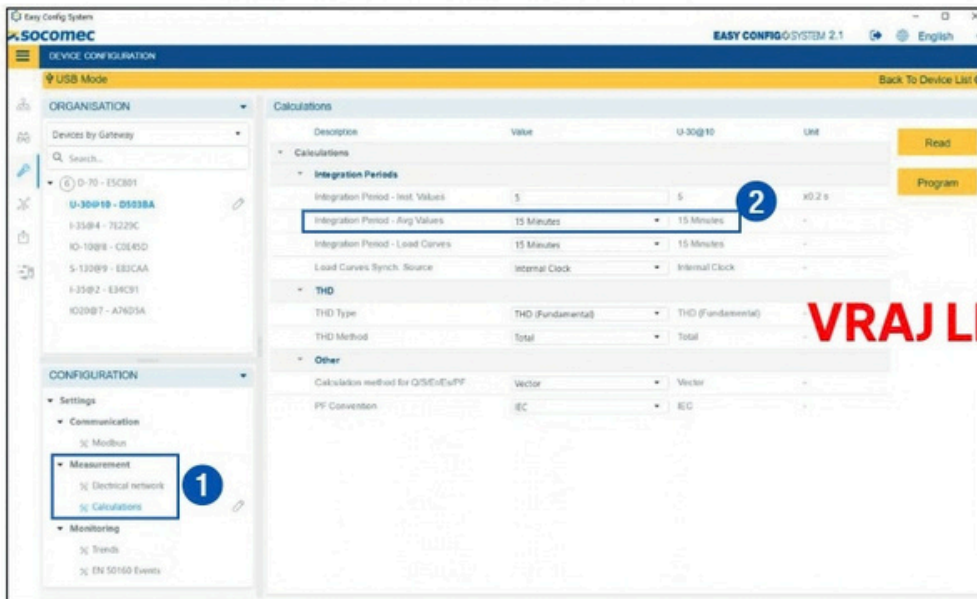

vrajlink.com

- Then you must go on each DIRIS Digiware I/S current module to select the electrical parameters you want to log (refer to next page).

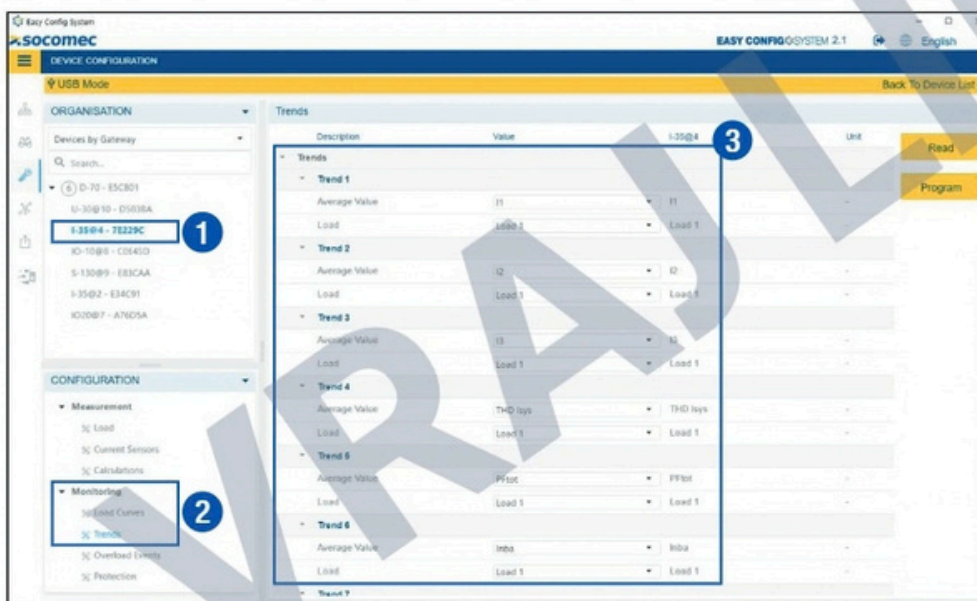

- 1 Select the DIRIS Digiware I/S current module to configure.

- 2 Go to the "Trends" menu.

- 3 Select the electrical parameters to log and their associated load.

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

10. FEATURES ASSOCIATED WITH THE TOKEN MODE

10.1. Introduction to the TOKEN mode

The TOKEN is a communication mode within the Digiware bus where there are **publishing** devices and **subscribing** devices

A **publishing device** can publish a service (alarm status for example) on the Digiware bus:

- DIRIS Digiware U-xx
- DIRIS Digiware I-xx
- Etc.

VRAJ LINK
vrajlink.com

A **subscribing device** can subscribe to a published service (alarm status)


- IO-10
- Etc.

The TOKEN mode only works on Digiware systems that include an M-50/M-70 gateway or a D-50/D-70 display (v2.3 firmware and above).

10.2. Alarm report on digital outputs of IO-10 module

10.2.1. Configuration

- 1 Click on the « Token » configuration menu.
- 2 Choose a PUBLISHING DEVICE.

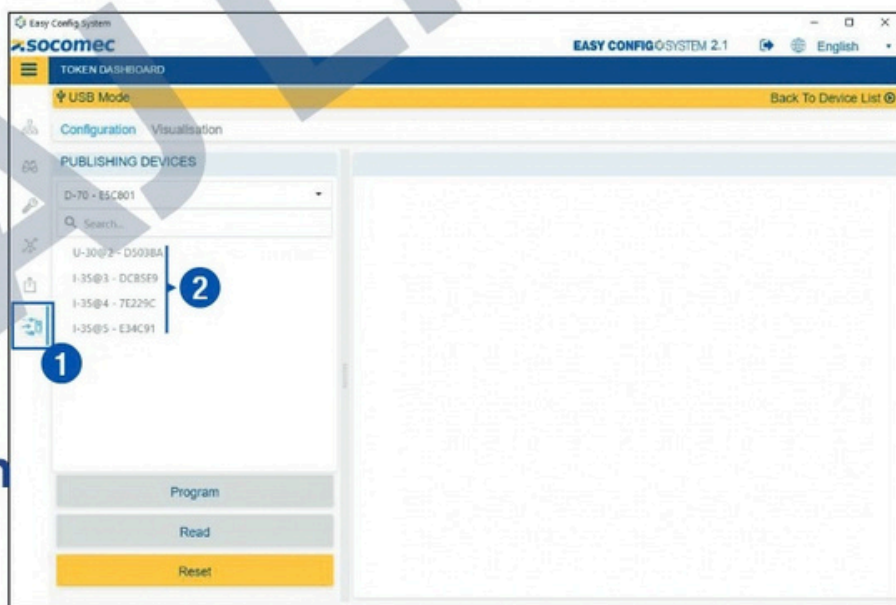

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978


- 3 Select the first service to publish (here a measurement alarm status).
- 4 Choose the alarm number (here the first Measurement Alarm of the U-30 module).
- 5 Choose the Subscribing Device (here the IO-10@8 module).
- 6 Choose the output to use for alarm report (here the output 1 of the IO-10@8 module).
- 7 Repeat the same operation for other services if needed.
- 8 Repeat the same operation for other DIRIS Digiware modules if needed.
- 9 Click on "Program".



i Once the Token is configured, the Digiware bus speed is automatically set to 500 kbps (both on U-xx module and D-xx display / M-xx gateway) and the COM LEDs of Digiware modules start blinking fast.

10.2.2. Visualisation

- 1 Click on "Visualisation" to view a summary of the Token configuration.
- 2 Choose a Subscribing Device from the list (here IO-10@8).
- 3 The list of services for which the IO-10 @8 module is subscribed to is displayed, along with the associated output.
- 4 The real time Output State is displayed. It changes upon the activation of the associated alarm.

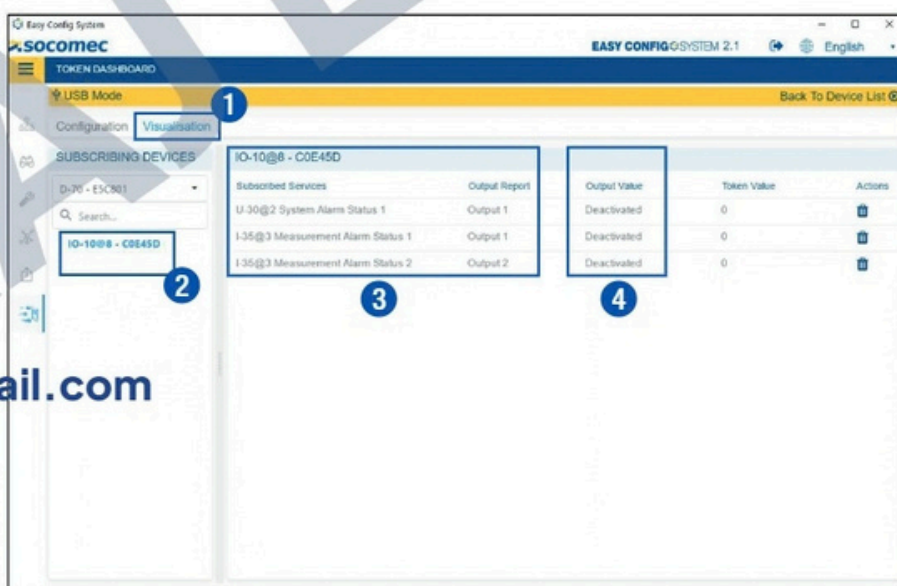

OFFICE WHATSAPP NUMBER : 9223310978

10.3. Tariff change via IO-10 module

The TOKEN mode also allows to use the digital inputs of a DIRIS Digiware IO-10 module to change the tariff for one or several DIRIS Digiware I / S current modules.


Tariff configuration of DIRIS Digiware I/S modules

- 1 Go to the “Settings” menu.
- 2 Click on the DIRIS Digiware I-xx or S-xx module which will be affected by the tariff management.
- 3 Go to “Tariff Management”.
- 4 Enter the number of tariffs.
- 5 Click on “Program”.



TOKEN mode configuration on IO-10 for multi-tariff management

- 1 Go the “TOKEN” configuration menu.
- 2 Select the DIRIS Digiware IO-10 which will control the tariff change.
- 3 Select “Tariff Change by digital inputs”.
- 4 Index always set to “1”.
- 5 Select the I-xx/S-xx module on which the IO-10 must change the tariff.
- 6 Reported Service set to “Tariff in Progress”.
- 7 Reported Service Index always set to “1”.
- 8 Click on “Program”.

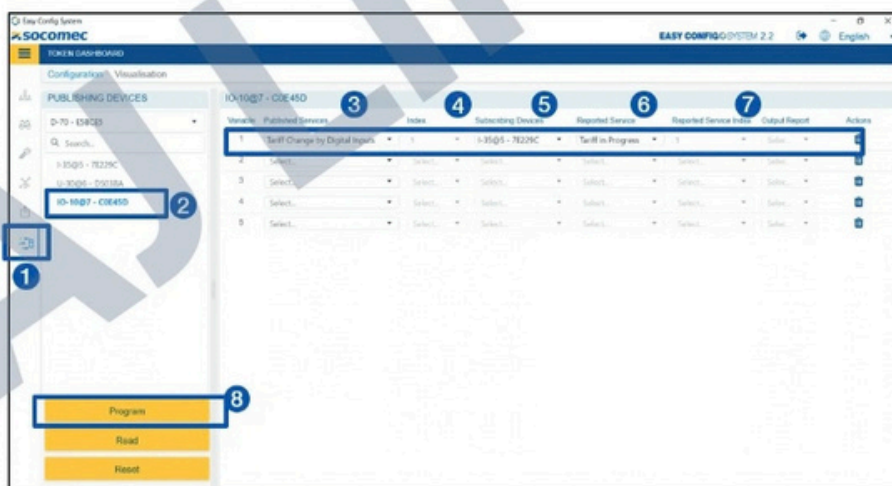

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

10.3.1. Rules on the digital input states of the IO-10 module

To control the tariff change (1 - 8) of the DIRIS Digiware I-xx / S-xx modules, only inputs 1 - 3 of the DIRIS Digiware IO-10 module are used.

The following table gives the current tariff number according to the digital input states of the IO-10 module:

		IO-10 Inputs		
		1	2	3
Tariff	T1	Off	Off	Off
	T2	On	Off	Off
	T3	Off	On	Off
	T4	On	On	Off
	T5	Off	Off	On
	T6	On	Off	On
	T7	Off	On	On
	T8	On	On	On

- Digital input states of IO-10 module

VRAJ LINK
vrajlink.com

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978


10.4. Synchronisation of load curves via IO-10 module

The TOKEN mode also allows to use the digital input of a DIRIS Digiware IO-10 module to synchronise the timestamp of the load curves of all the DIRIS Digiware I-xx / S-xx current modules within the same Digiware bus with an external signal (for example the sync. signal from the energy supplier).

VRAJ LINK
vrajlink.com


Configuration of the synch. source on the DIRIS Digiware U-xx module

- 1 Go to the "Settings" menu.
- 2 Click on the DIRIS Digiware U-xx module.
- 3 In the "Calculation" menu, set the Load Curves Synch. Source to "Communication".
- 4 Click on "Program".

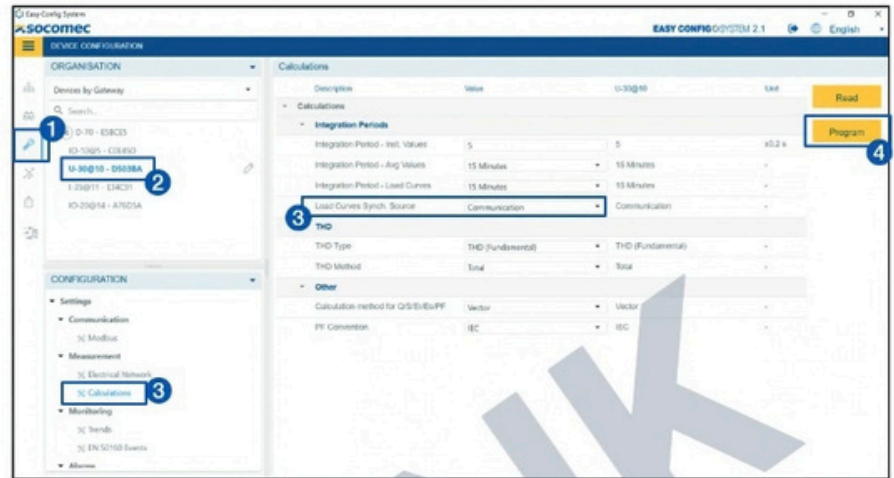

Configuration of the DIRIS Digiware IO-10's digital input

- 1 Click on the DIRIS Digiware IO-10 module.
- 2 In the "Digital Input" menu, set the input 1 of the IO-10 module to "External Synch. Signal".
- 3 Click on "Program".

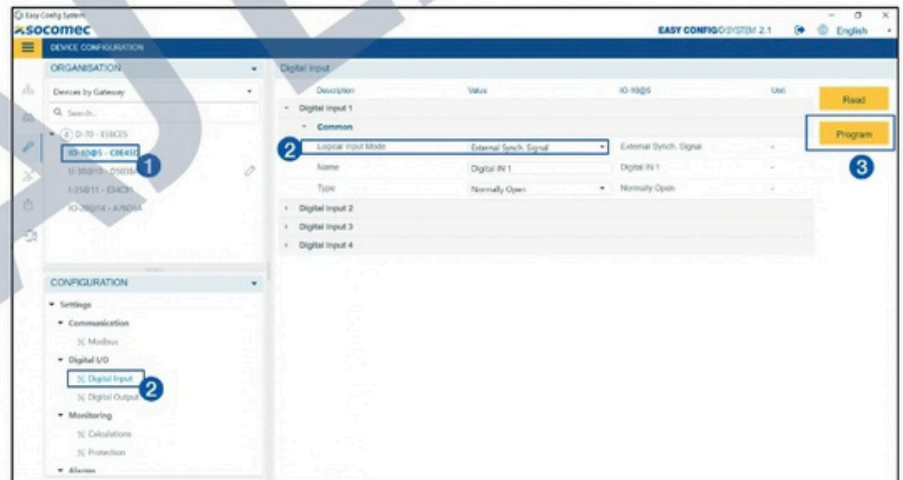


The Synch. Signal function can only be used on input no 1 of the DIRIS Digiware IO-10 module.

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

TOKEN mode configuration on IO-10 for the synchronisation of load curves

- 1 Go to the "TOKEN" configuration menu.
- 2 Select the DIRIS Digiware IO-10 module which will drive the load curves synchronization.
- 3 Select "Synch. Signal Input".
- 4 Index always set to "1".
- 5 Select the DIRIS Digiware U-xx module as the subscribing device.
- 6 Reported Service set to "Synch. Signal".
- 7 Reported Service Index always set to "1".
- 8 Click on "Program".

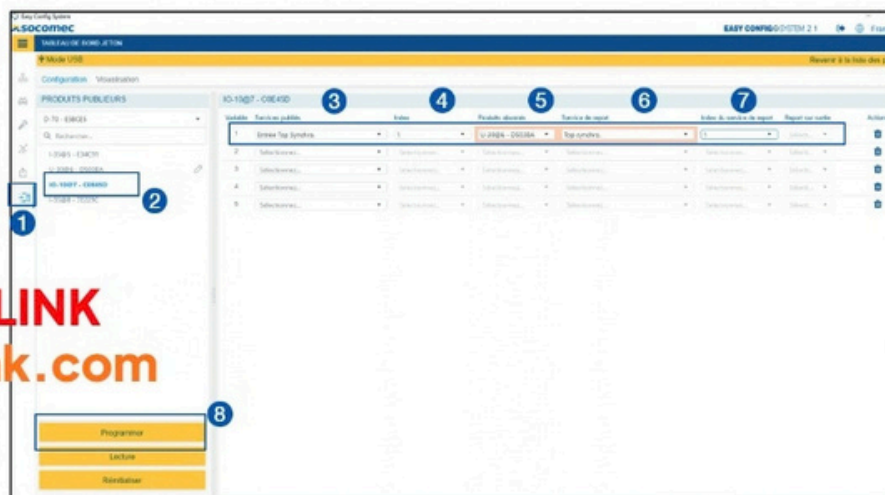

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

VRAJ LINK

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978

VRAJ LINK

CORPORATE HQ CONTACT:
SOCOMECSAS
1-4 RUE DE WESTHOUSE
67235 BENFELD, FRANCE

www.socomec.com

vrajlink07@gmail.com

OFFICE WHATSAPP NUMBER : 9223310978



551765B